<section-header><section-header><section-header></section-header></section-header></section-header>	 Your new electronic digital thermostat has been designed to provide accurate control and display of room temperature. In addition, it also will display all relevant information pertaining to your system. The clearly marked buttons and informative display make it extremely easy to understand and simple to use. Please take a few moments to read the brief instructions and familiarize yourself with the various functions in order to obtain maximum benefit from this truly unique electronic control. DENERAL INFORMATION The thermostat normally displays room temperature, mode of operation and whether cooling or heating is currently on. The six buttons on the front of the unit allow complete control of your equipment. You may select different heating and cooling setpoints for the system to maintain, e.g., 70° in heating and 75° in cooling. Raising or lowering the setpoints in heating or cooling is as simple as pushing a button. In addition, you may choose to display the temperature in °F or °C. The thermostat also allows you to select continuous fan operation (useful when using an air cleaner) or have the fan come on with the equipment. 	<text><list-item><list-item><list-item><list-item><list-item><list-item><text></text></list-item></list-item></list-item></list-item></list-item></list-item></text>	<text><text><text><section-header><text><text><text><text><text><text></text></text></text></text></text></text></section-header></text></text></text>
<section-header><section-header><section-header><section-header><section-header><section-header><section-header><section-header><section-header><text></text></section-header></section-header></section-header></section-header></section-header></section-header></section-header></section-header></section-header>	 REMOTE SENSOR (OPTION) 6 RS1 - RS2 - RS+V The thermostat is designed to accept the electronic remote sensor, which will allow you to locate your thermostat in an area away from view. Indoor and outdoor sensors are available separately. CLOCK TERMINALS (OPTION) CLK1 - CLK2 Your thermostat is equipped with a dry contact closure input. By connecting to any relay-based controller or clock timer, the thermostat can be alternated between the day and night (setback) temperature setpoints automatically. Upon initial power up of the thermostat, or after a power failure, the thermostat will check the clock terminals and apply the day (open contact) or night (closed contact) temperature setpoints accordingly. ECONOMY / COMFORT During operation, the thermostat automatically calculates the amount of time required to reach the desired setpoint based on the current trending rate of the temperature. In the economy mode (switch #5 OFF), the thermostat will turn the 2nd stage ON if the calculated time to achieve the setpoint is 3 hours or more. In the comfort mode, the 2nd stage will turn on if the calculated time is 90 minutes or greater. TEMPERATURE ACCURACY Full temperature accuracy will be realized only after the thermostat has been installed and powered for at least one (1) hour. THERMOSTAT AND SENSOR CALIBRATION Simply press and hold the FAN button for 10 seconds and adjust with the V or A button. 	<text><text><text><text><section-header><text><text></text></text></section-header></text></text></text></text>	<section-header><section-header><section-header><section-header><section-header><section-header><section-header></section-header></section-header></section-header></section-header></section-header></section-header></section-header>

INSTALLATION INSTRUCTIONS

It is recommended that installation be performed by a qualified installer.

Location


To ensure proper operation, the thermostat should be mounted on an inside wall in a frequently occupied area of the building. In addition, its position must be at least 18" (46cm) from any outside wall, and approximately 5' (1.5m) above the floor in a location with freely circulating air of an average temperature. You should avoid the following locations:

- behind doors or in corners where freely circulating air is unavailable: - where direct sunlight or radiant heat from appliances might affect control operation:
- on an outside wall:
- adjacent to, or in line with, conditioned air discharge grilles, stairwells. or outside doors:
- where its operation may be affected by steam or water pipes or warm air stacks in an adjacent partition space, or by an area behind the thermostat which is not climate controlled:
- where its operation will be affected by the supply air of an adjacent climate control HVAC device:
- near sources of electrical interference such as arcing relay contacts.

Removing the Thermostat from the Subbase

1. Insert a flat blade screwdriver or coin 1/8" into the slot located in the bottom center of the thermostat case and twist 1/4 turn. When you feel or hear a click, grasp the case from the bottom two corners and separate from the subbase.

- 2. Swing the thermostat out from the bottom. 3. Lift the thermostat up and off the subbase.
- 4. Place the rectangular opening in the subbase over the equipment
- control wires protruding from the wall and, using the subbase as a template, mark the location of the two mounting holes (exact vertical mounting is necessary only for appearance).
- 5. Use the supplied anchors and screws for mounting on drywall or plaster; drill two 3/16" (5mm) diameter holes at the marked locations; use a hammer to tap the nylon anchors in flush to the wall surface and fasten subbase using the supplied screws. (Do not overtighten!)
- 6. Connect the wires from your system to the thermostat terminals. Carefully dress the wires so that any excess is pushed back into the wall cavity or junction box. Ensure that the wires are flush to the plastic subbase. The access hole should be sealed or stuffed to prevent drafts from affecting the thermostat.



Replacing the Thermostat on Subbase

10

1. Position the thermostat on the hinged tabs at the top of the subbase.

2. Gently swing the thermostat down and press on the bottom center until it snaps into place.

Thermostat Cover Lock

Insert the plastic lock piece into the bottom of the mounted base. The ends of the lock piece fit snugly under the lock pins extending from the bottom of the mounted base. The tab in the middle of the lock piece extends down from the base.


To release the locking mechanism, press the lock piece up and into the base while gently prying open.

Thermistor Mounting Instructions

When placing the front cover on the thermostat ensure the thermistor is not bent or misaligned. Ensure that the thermistor does not


touch the thermostat case. The thermistor should be placed horizontal to the wall. Ensure the thermistor is not pushed upward into the case. The thermistor should be aligned so it is

visible between the ribs on the bottom of the subbase.



Display icons vary according to the model. Your thermostat may not display all of the icons shown.

WIRING DIAGRAM

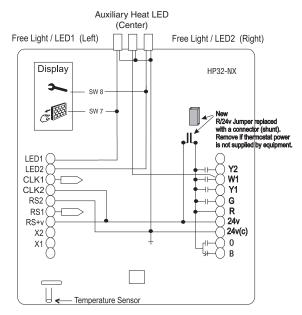

Note: If the 24V(c) is not available from the equipment the jumper may be removed and a separate 24V transformer must be used to power the thermostat.

This thermostat may be used with 24 Volt DC. The negative side of the DC supply must be wired to the 24V (c) terminal.

Y2Compressor is energized for 2nd stage heating or o	cooling if
multistage is selected	

- W1.....Auxiliary heat is energized as back-up or emergency heat Y1.....Compressor is energized with a call for heating or cooling G.....
- .Fan operates with a call for heating or cooling or by pressing the FAN button. ...Power from equipment R

TERMINAL DESIGNATIONS

13

24V ...24 VAC hot and common to power the thermostat 24V(c)

- 0..... Energizes the reversing valve continuously in cool mode Energizes the reversing valve continuously in heat or off B..... modes
- RS2. .Use to connect up to 6 (XC-IDS) indoor and/or 1
- RS1 (XC-ODT) outdoor remote sensor/s.
- RS+V When connected the thermostat will automatically use the XC-IDS temperature sensor and not its own. Refer to the instructions included with the sensor.

LED1. ... Free lights for status or function indication. LED2

CLK1.Use with dry contact relay for alternate setpoints CLK2

X1.... .Remote communications. Refer to the instructions included with the remote communications adapter and software.

X2... .X1 return, connected to 24V(c)

14 **DIP SWITCH OPTIONS AND FUNCTIONS** Positioning the DIP switches in either the ON or OFF position enables you to

choose between two different options. The DIP switches are located on the interior of your thermostat and may be accessed by following the procedure for removing the thermostat from the subbase. The following list describes your DIP switch options.

DIP Switch	DIP Switch OFF	DIP Switch ON
1	Normal	Add on
2	1 hour override	3 hour override
3	4 minute minimum ON	2 minute minimum ON
4	Keypad unlock	Keypad lock
5	Economy	Comfort
6	Single stage LED #1+no icon	Multi-stage LED #1+ 🔊 filter icon
7		
8	LED #2+no icon	LED #2+ 🛰 fault icor

1. Normal or Add-On Heat Pump In the normal position the thermostat will allow the compressor and the auxiliary heat to be on at the same time. In the add-on position, the compressor is turned off with a call for auxiliary heat. 2. Temperature Override Sets a temperature override to either 1 hour or 3

hours when the keypad is locked. 3. 2 Minute or 4 Minute On Times This option allows you to run the equip-

ment for either a 2 or 4 minute minimum off and on time.

4. Keypad Lock a In the ON position locks out all buttons except the OUTDOOR temperature button.

5. Economy/Comfort In the OFF position, the thermostat will be in economy mode. In the ON position the thermostat will be in comfort mode.

6. Single or Multi-stage Set to OFF for 1 compressor stage of heating or cooling (single stage) or ON for equipment with 2 compressor stages of heating and/or cooling (multi-stage).

7. LED #1 + Indication In the OFF position LED #1 will light when the terminal is energized. In the ON position LED #1 will light and a filter # icon will be displayed on the LCD when the terminal is energized.

8. LED #2 + Indication In the OFF position LED #2 will light when the terminal is energized. In the ON position LED #2 will light and a fault > icon will be displayed on the LCD when the terminal is energized.

SPECIFICATIONS

HPT-2

15

11

<Thermistc

Code

and the second s

Fhermostat Cover Lock

Caree and a second s

100000

finged

Tabš

Rated A.C. 0.050 Amps to 0.75 Amps continuous Current per output with surges to 3 Amps Max. Rated D.C. 0 Amps to 0.75 Amps continuous ControlHeating: 38° to 88°F in 1° Steps Range 5° to 30°C in 1° Steps Cooling: 60° to 108°F in 1° Steps 16° to 40°C in 1° Steps Thermostat Measurement Range ... 28° to 124°F or 0° to 48°C O.D.T. Displayed Minimum (between heating and cooling)

NOTE: This thermostat contains electronic circuitry replacing the conventional mechanical anticipator.

16

354-00021-001 Rev A